

1. STAGE 1 _____
2. STAGE 2 _____
3. STAGE 3 _____
4. HYPOT _____
5. TESTED _____
6. Q.C. _____

MARQUIS CORPORATION
 52148-05
 MODEL LZRIU

240V, 4KW
 HEATER, MAX.

GROUND

Balboa Instruments Incorporated
 BALBOA INSTRUMENTS INC.
 COSTA MESA, CA.


Certified to comply with the limits for a class B computing device pursuant to subpart J of part 15 of the FCC rules

LISTED
 ETL
 80593926630

MODEL: **WH-LZRIU-CCAJ**
 60 HZ

PAT. NO. 4618797 MADE IN USA

G R N	R E D	B L K	W H T
Ground	Hot	Hot	Neutral
USE COPPER		120V/240V	
WIRE MIN. 8 AWG		16A/32A 60Hz	

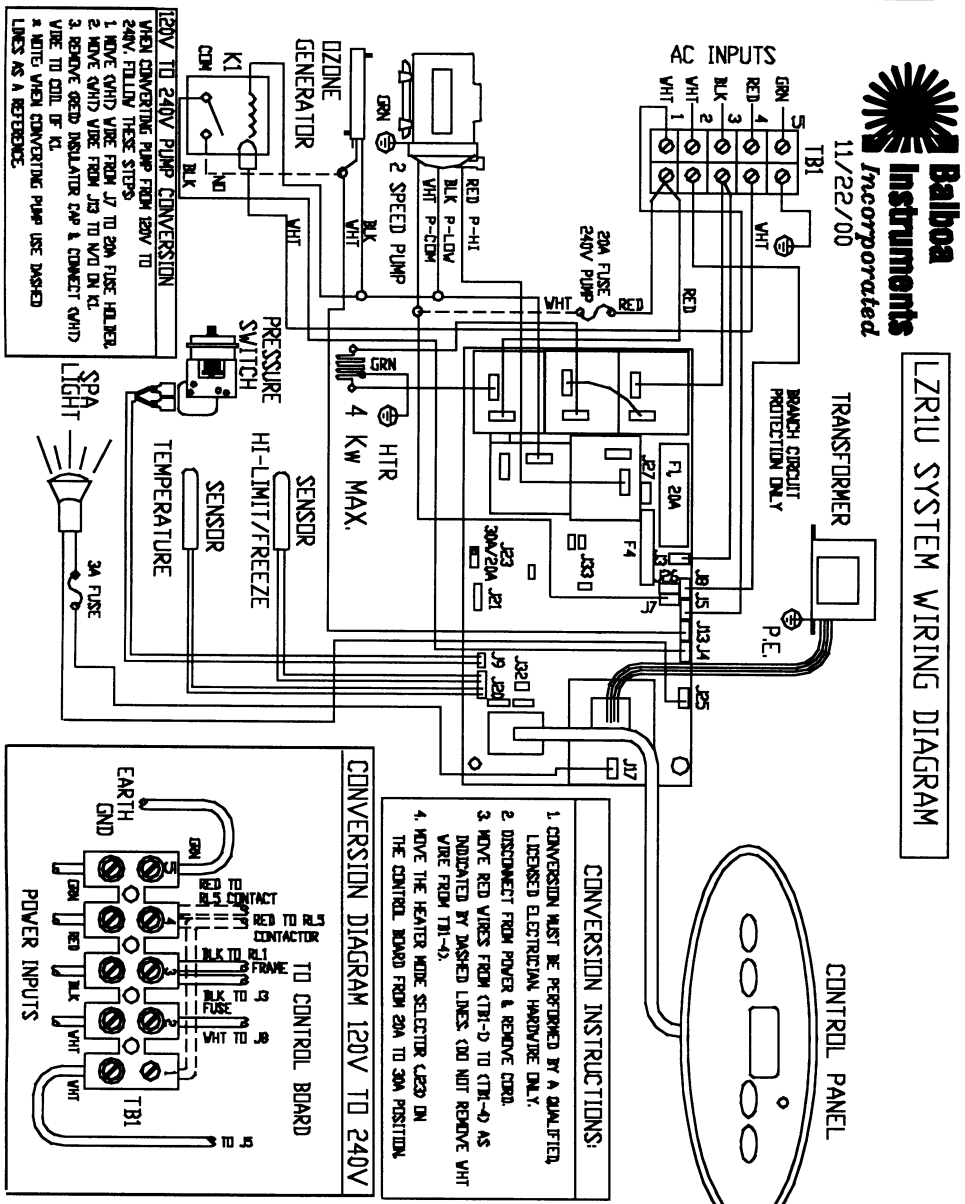

LZRIU SYSTEM WIRING DIAGRAM

J&J P/N#
 OZONE
 20259

If this unit is to be permanently connected, connect only to a circuit that is protected by a ground fault circuit interrupter (G.F.C.I.).