

P/N 53171HC1
MODEL M2

Balboa Instruments
Incorporated
BALBOA INSTRUMENTS INC.
TUSTIN, CA.

Certified to comply with the limits for a class B computing device pursuant to subpart J of part 15 of the FCC rules

MODEL DE-M2-GCA


PAT. NO. 4618797

ETL US
74254

60 HZ


USE COPPER
CONDUCTOR
ONLY
#6 AWG MIN.
WIRE = 90/75C
EMPLOYER
UNIQUEMENT
DES
CONDUCTEURS
DE CUIVRE
TORQUE RANGE
FOR TBI:
16-18 IN. LBS

USE COPPER WIRE
MIN 10 AWG
@ 105°C

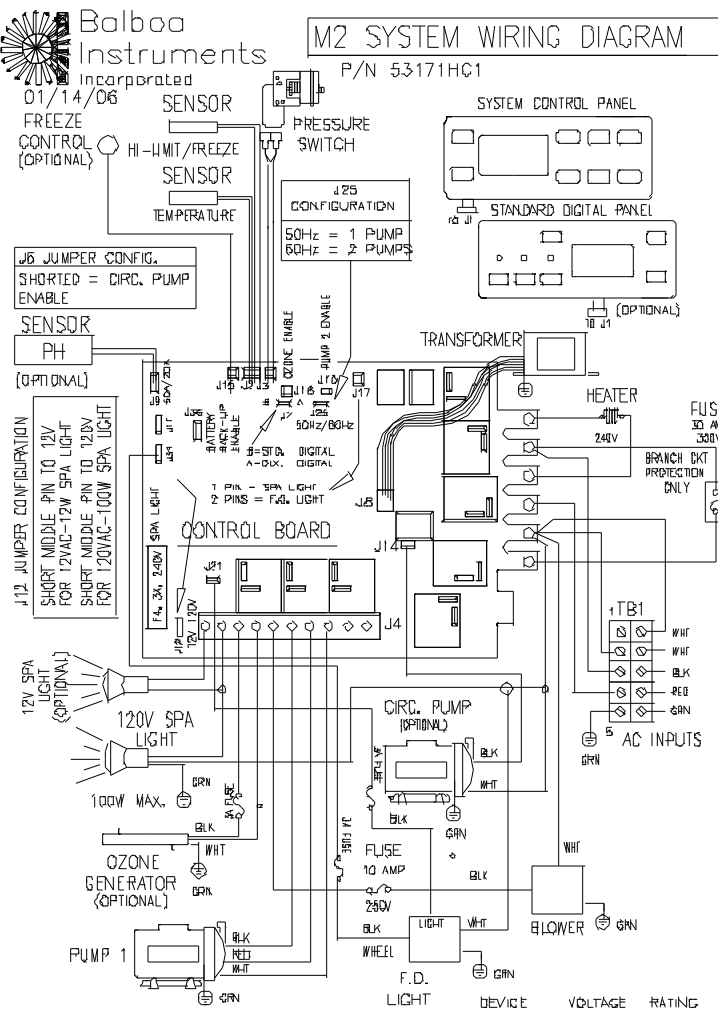

"A disconnecting means must be installed within sight from the equipment and at least 5 feet (1.52 m) from the inside walls of the pool, spa, or hot tub."

CONVERSION DIAGRAM 120V TO 240V

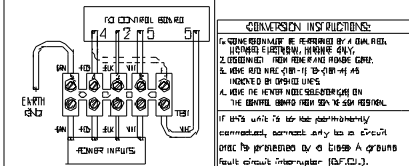

DEVICE	VOLTAGE	RATING
PUMP1	120/240V	15/12A
CIRC PUMP	120V	4A
OZONE	120/240V	1A
SPA LIGHT	12V	12W
FIBER OPTIC	120V	2A
BLOWER	120V	8A
SPA LIGHT2	120V	100W
HEATER	120/240V	1.4KW/5.5KW

TOTAL OUTPUT AMPERAGE SHALL NOT EXCEED MAX INPUT RATINGS OF SPA.