

P/N 54160HC2
MODEL VALUE



Balboa
Instruments
Incorporated

LISTED



B0593926630

Certified to comply with
the limits for a class B
computing device pursuant
to subpart J of part 15
of the FCC rules

60 HZ

MODEL: WH-VALUE-CCAH


PAT. NO. 4618797

USE COPPER
CONDUCTOR
ONLY
#6 AWG MIN.
WIRE= 90°C

EMPLOYER
UNIQUEMENT
DES
CONDUCTEURS
DE CUIVRE.

TORQUE RANGE
FOR TB1:
21-25 IN. LBS

FOR SUPPLY CONNECTIONS, USE CONDUCTORS
SIZED ON THE BASIS OF 60°C AMPACITY BUT
RATED MINIMUM OF 90°C.

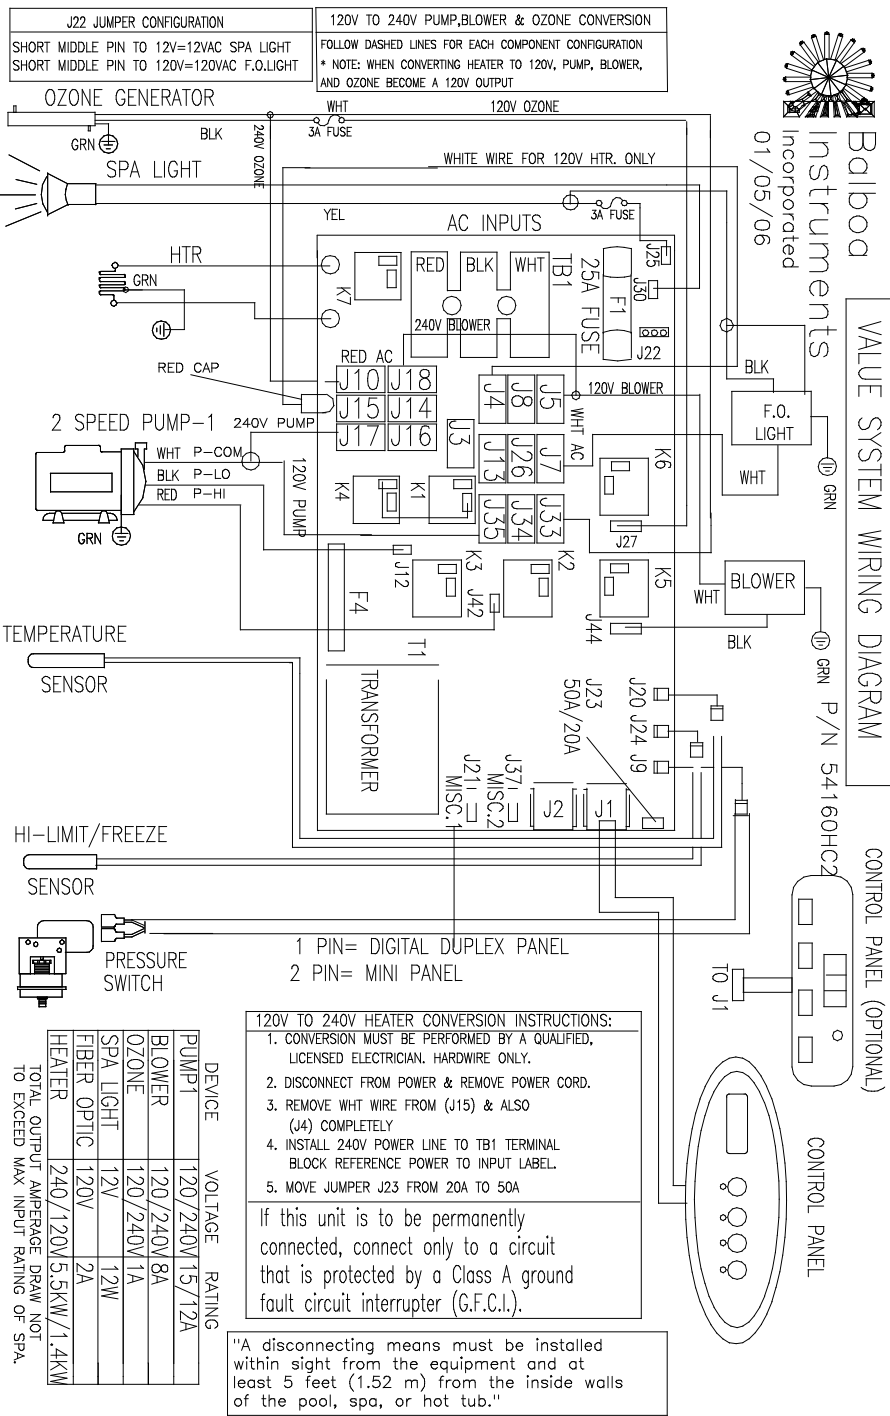

Balboa
Instruments
Incorporated
01/05/06

VALUE SYSTEM WIRING DIAGRAM

CONTROL PANEL (OPTIONAL)

CONTROL PANEL