


TO CONVERT CIRCUIT 120 OR 240V MOVE WHITE WIRE ACCORDINGLY
 120V COMPONENT = OPEN POSITION AT CONNECTION BLOCK "N"
 240V COMPONENT = OPEN POSITION AT CONNECTION BLOCK "L2"

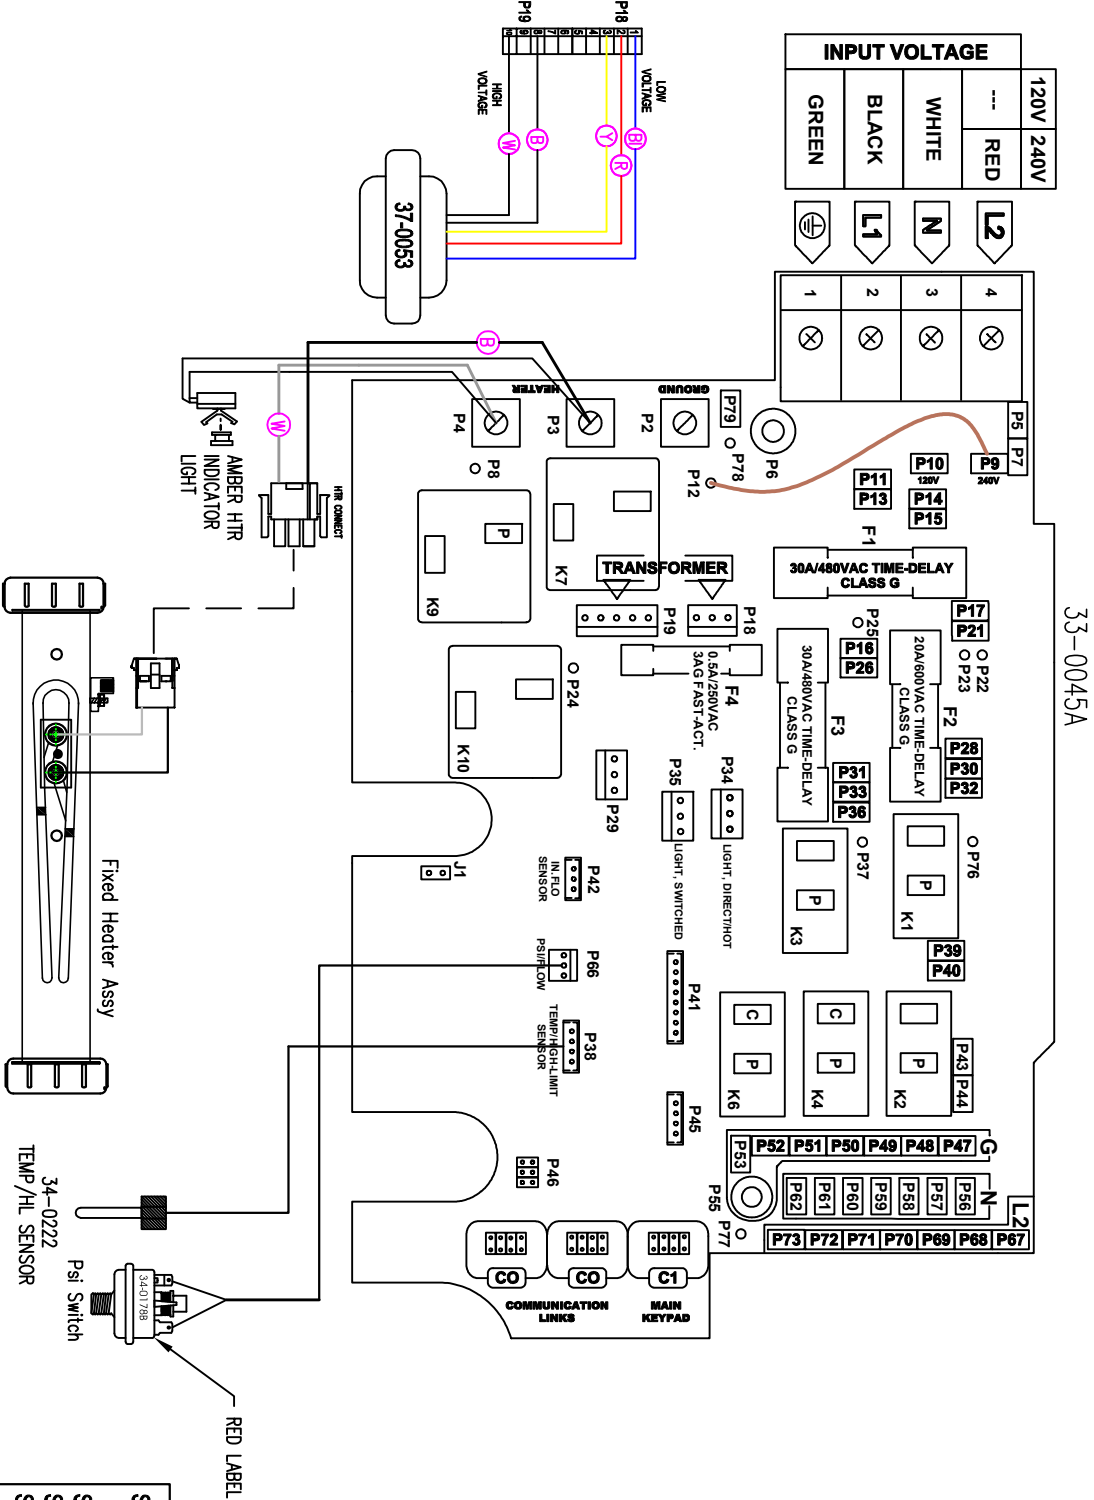


HYDRO-QUIP
 CORONA, CA (951) 273-7575

Manufacture Notes:

A disconnect means must be installed within sight from the equipment and at least five feet (1.52m) from the inside walls of pool, spa, or hot tub.

System Setup Options (see manual to access these settings):
 Setup #10: System without Circulation Pump (DEFAULT)
 Setup #11: System with 24hr Circulation Pump
 Setup #12: System with Thermostatic/Filtration Circulation Pump

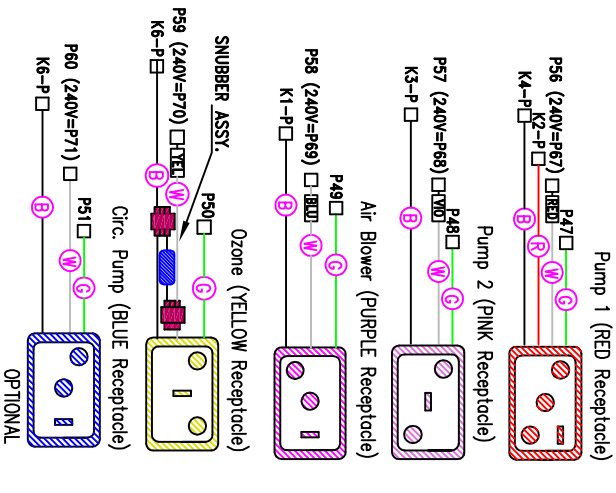

Drawn	Rev	Wire Color Code
MBS	01	B - Black
Date		Br - Brown
10.14.20		G - Green
Diagram		R - Red
No. 9130		O - Orange
		Y - Yellow
		W - White
		Gr - Gray