


TO CONVERT CIRCUIT 120 OR 240V MOVE WHITE WIRE ACCORDINGLY
 120V COMPONENT = OPEN POSITION AT CONNECTION BLOCK "N"
 240V COMPONENT = OPEN POSITION AT CONNECTION BLOCK "L2"

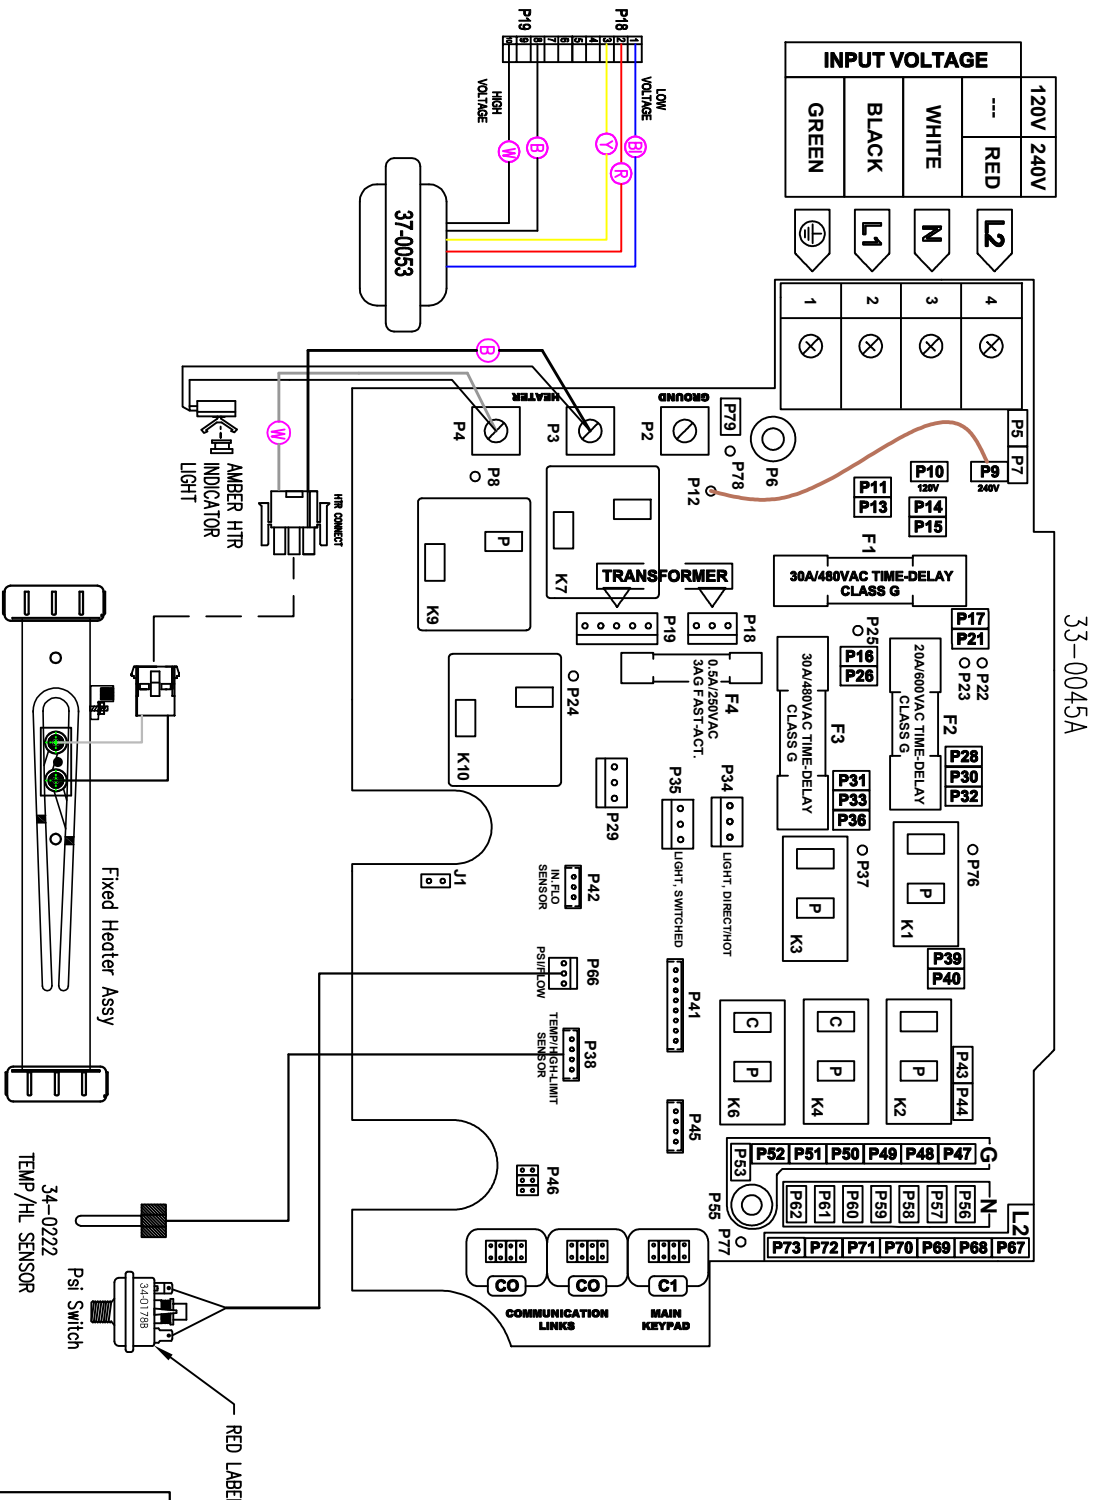

33-0045A

HYDRO-QUIP
 CORONA, CA (951) 273-7575

Manufacture Notes:

A disconnect means must be installed within sight from the equipment and at least five feet (1.52m) from the inside walls of pool, spa, or hot tub.

System Setup Options (see manual to access these settings):
 Setup #4: System without Circulation Pump (DEFAULT)
 Setup #5: System with 24hr Circulation Pump
 Setup #6: System with Thermostatic/Filtration Circulation Pump

Drawn	Rev	Wire Color Code
MBS	01	B - Black Br - Brown R - Red O - Orange Y - Yellow
Date	10.14.20	G - Green Bl - Blue V - Violet W - White Gr - Grey
Diagram No.	9157	

